

DATALOGGER ModBUS RTU

MANUAL and SOFTWARE

To obtain manual please go to

www.adfweb.com/download


OR

[www.adfweb.com/download/filefold/Datalogger Modbus RTU Master MN67112 ENG.pdf](http://www.adfweb.com/download/filefold/Datalogger%20Modbus%20RTU%20Master%20MN67112%20ENG.pdf)

To obtain the new version of this box sheet please go to

[http://www.adfweb.com/download/filefold/BS67112 ENG.pdf](http://www.adfweb.com/download/filefold/BS67112%20ENG.pdf)

CONNECTION SCHEME:

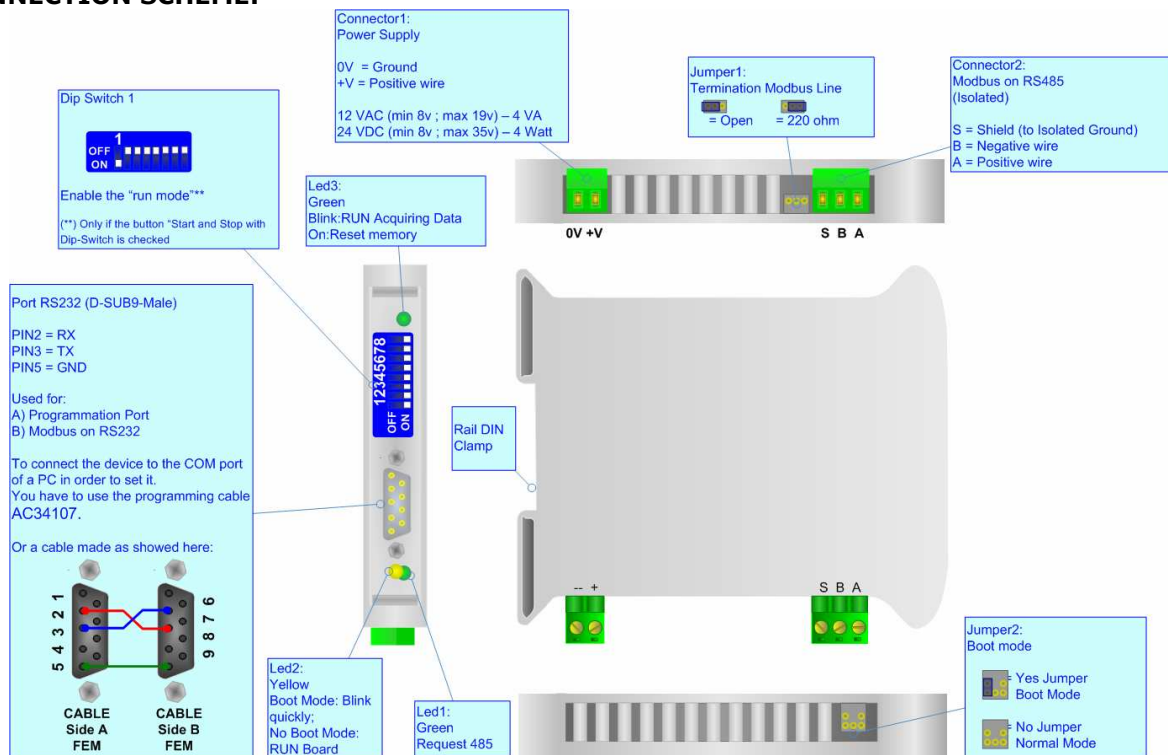

CHARACTERISTICS OF THE CABLES:

For using DataLogger you need the software named SW67112. To obtain this software please go to


www.adfweb.com/download

OR

www.adfweb.com/download/filefold/SW67112.zip

The connection from RS232 socket to a serial port (example one from a personal computer), must be made with a NULL MODEM cable (a serial cable where the pins 2 and 3 are crossed).

It is recommended that the RS232C Cable not exceed 15 meters.

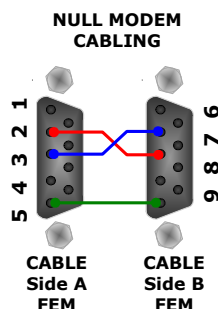

ADFweb.com s.r.l.
 www.adfweb.com
 info@adfweb.com
 support@adfweb.com