

Gateway / Bridge DeviceNet to PROFIBUS Slave

To obtain the complete manual please go to

www.adfweb.com/download


OR

www.adfweb.com/download/filefold/DeviceNet_PROFIBUS_Slave_MN67554_ENG.pdf

To obtain the new version of this box sheet please go to

http://www.adfweb.com/download/filefold/BS67554_ENG.pdf

CONNECTION SCHEME

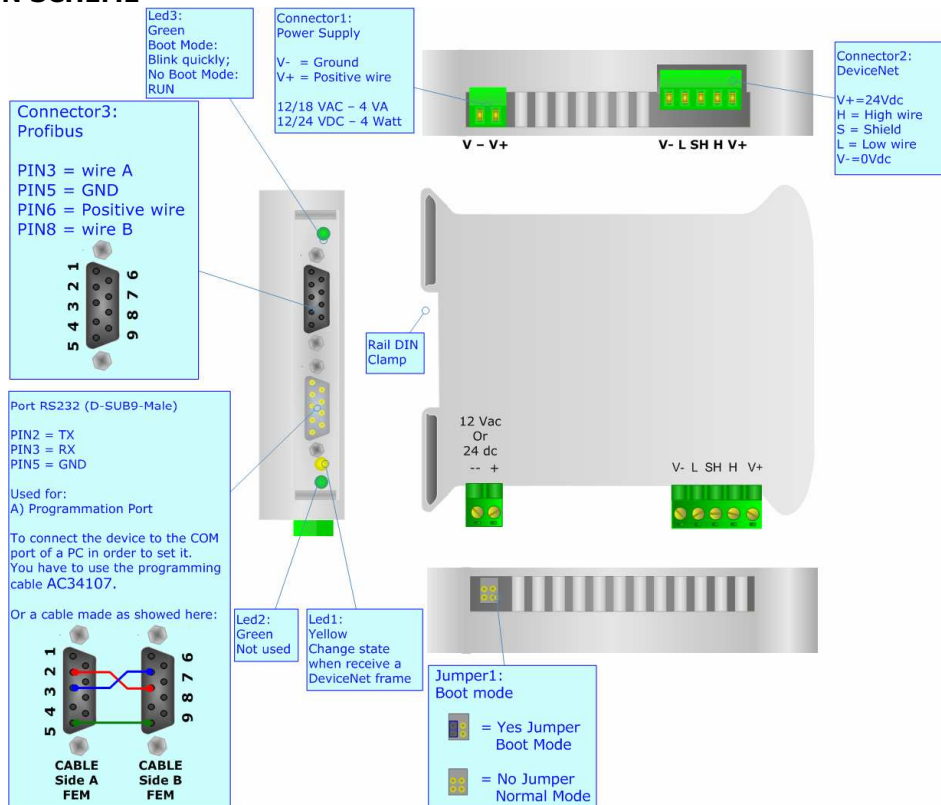

THE CONFIGURATION SOFTWARE:

For setting up the device you need a the software named SW67554. To obtain this software please go to

<http://www.adfweb.com/download>


OR

<http://www.adfweb.com/download/filefold/SW67554.zip>

CHARACTERISTICS OF THE CABLES:

The connection from RS232 socket to a serial port must be made with a NULL MODEM cable (a serial cable where the pins 2 and 3 are crossed).

It is recommended that the RS232C Cable not exceed 15 meters.



ADFweb.com s.r.l.
www.adfweb.com
info@adfweb.com
support@adfweb.com